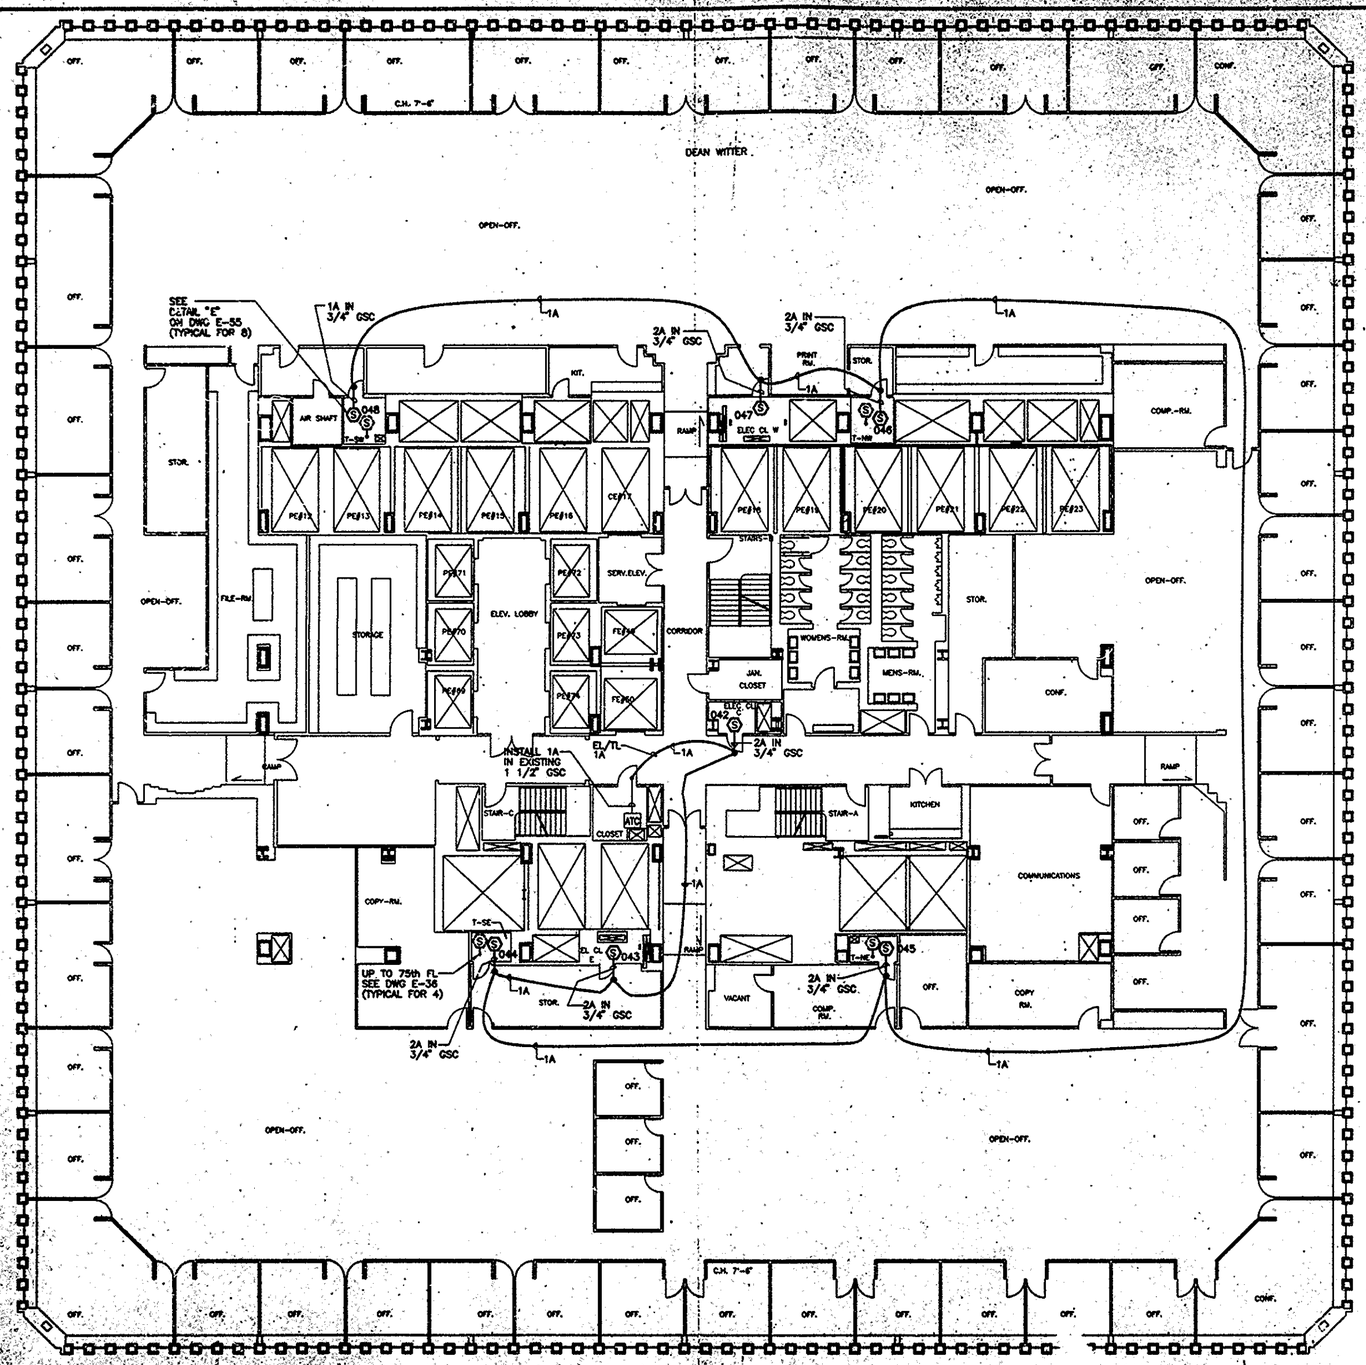


## NOTE:

1. FOR LEGEND, ABBREVIATIONS AND GENERAL NOTES, SEE DWG E-1.
2. FOR SMOKE DETECTOR INSTALLATION DETAILS, SEE DWG E-55.
3. FOR TELEPHONE AND ELECTRIC CLOSETS SMOKE DETECTOR RISER DIAGRAM, SEE DWG E-42.

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. WTC-861.08 IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.

DATE 2/1/00 CONTR. OF ENGR./ARCH.

DATE 2/8/00 ENGINEERING PROGRAM MGR.




KEY PLAN

0 6 12 18 24
SCALE IN FEET

Sheet 54 of 58

THE PORT AUTHORITY OF NY & NJ

ENGINEERING PROGRAM MANAGER WORLD TRADE

CHIEF ELECTRICAL ENGINEER

| No. | Date | Revision | Approved |
|---|---|---|---|

Engineering Department
Design Division
The World Trade Center

Title
**FIRE ALARM SYSTEM PHASE III XL3 CONVERSION**

**ELECTRICAL**

**2 WTC 74th FLOOR SMOKE DETECTOR LAYOUT**

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

| Designed by | Drawn by | Checked by |
|---|---|---|
| ROYZMAN FELDSTEIN | ROYZMAN | A.S. |

Date 5-20-99 Scale AS NOTED

Contract Number WTC-861.082 Drawing Number E-52